


2 P.O.S. SYSTEM CONDUIT/CABLING SCHEMATIC
N.T.S.

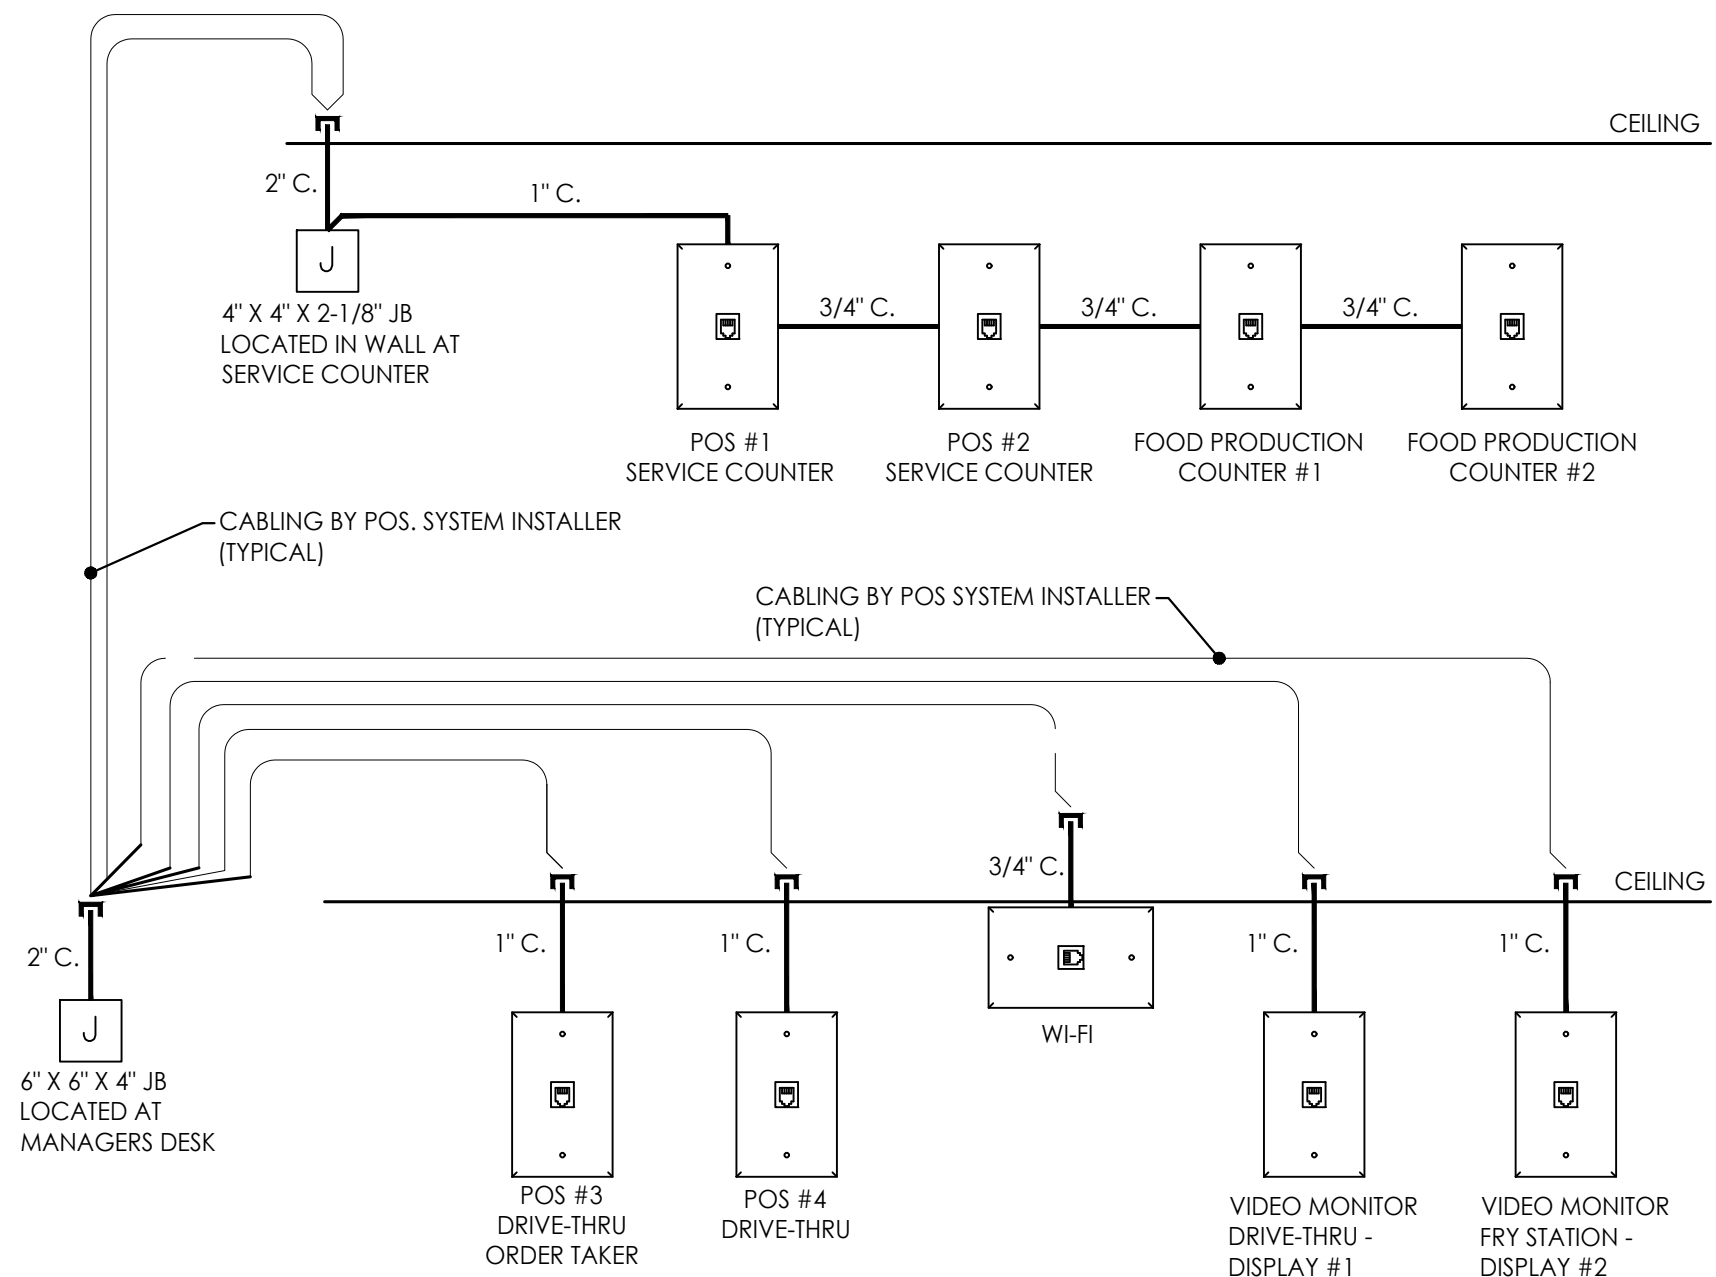

- CODED NOTES:** (#)
1. PROVIDE 1" CONDUIT FROM WALL JUNCTION BOX.
 2. PROVIDE JUNCTION BOX AND 2" CONDUIT FOR POS SYSTEM. COORDINATE WITH POS INSTALLER PRIOR TO ROUGH-IN. SEE SCHEMATIC THIS SHEET.
 3. PROVIDE JUNCTION BOX AND 1" CONDUIT FOR POS SYSTEM. COORDINATE WITH POS INSTALLER PRIOR TO ROUGH-IN. SEE CONDUIT/CABLING SCHEMATIC THIS SHEET FOR MORE INFORMATION.
 4. PROVIDE JUNCTION BOX WITH PULL STRING AND (1) "8P8C" CONNECTOR ABOVE CEILING. SECURE TO LOBBY SIDE OF TRUSS ABOVE DECOR WALL FOR FUTURE WIFI. COORDINATE EXACT LOCATION WITH GENERAL CONTRACTOR.
 5. PROVIDE JUNCTION BOX AND (2) 3/4" EMPTY CONDUITS WITH PULLSTRING TO ABOVE ACCESSIBLE CEILING FOR (2) "RJ11" PHONE JACKS (BY OTHERS).
 6. PROVIDE EMPTY 2" CONDUIT WITH PULLSTRING FROM 6"x6"x4" JUNCTION BOX TO ABOVE ACCESSIBLE CEILING FOR POS SYSTEM CABLES.
 7. PROVIDE JUNCTION BOX FOR PHONE/DATA PUNCH PANEL LOCATED BELOW ITB.
 8. PROVIDE 3/4" CONDUIT RUN IN HALF WALL.
 9. PROVIDE CONDUIT UNDERGROUND BACK TO MANAGERS DESK.

STATE OF ARKANSAS
LICENSED PROFESSIONAL ENGINEER
No. 18164
AARON B. MORSE
10-21-21

PROPRIETARY INFORMATION NOTICE:
THESE PROTOTYPICAL DOCUMENTS MAY REQUIRE REVISIONS TO CONFORM TO LOCAL, STATE, AND FEDERAL CODES, ORDINANCES OR OTHER CONDITIONS. THE DESIGN CONCEPTS EMBODIED IN THESE DOCUMENTS ARE SPECIFICALLY FOR THIS PROJECT. INFORMATION CONTAINED HEREIN REMAINS THE SOLE PROPERTY OF ARBY'S RESTAURANT GROUP, IS CONFIDENTIAL AND PROPRIETARY AND IS NOT TO BE COPIED, REPRODUCED, DISCLOSED OR OTHERWISE TRANSFERRED TO OTHER PARTIES IN ANY FORM WHATSOEVER WITHOUT THE EXPRESS WRITTEN CONSENT OF ARBY'S RESTAURANT GROUP.

Copyright 2020 by Arby's Restaurant Group

ARBY'S RESTAURANT GROUP
INSPIRE DUAL REGULAR 40 - STANDARD
1632 AR-25 BYPASS
HEBER SPRINGS, AR 72543
FOR
RB AMERICAN GROUP, LLC
6200 OAK TREE BLVD., SUITE 250, INDEPENDENCE, OHIO 44131

PROJECT NUMBER:

ISSUE	DATE
PRELIMINARY	
PERMIT	
BID	
REVISION	

POS SYSTEMS PLAN

SHEET:

E2.2