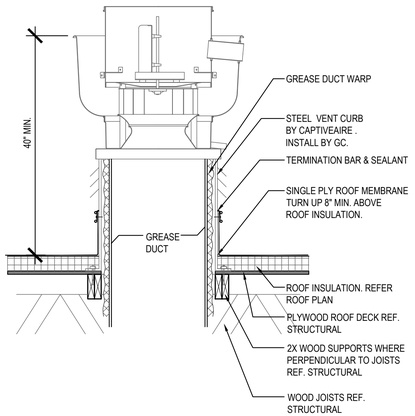

ROOF EXHAUST FAN 5

Scale= 1/4" = 1'-0" A-108

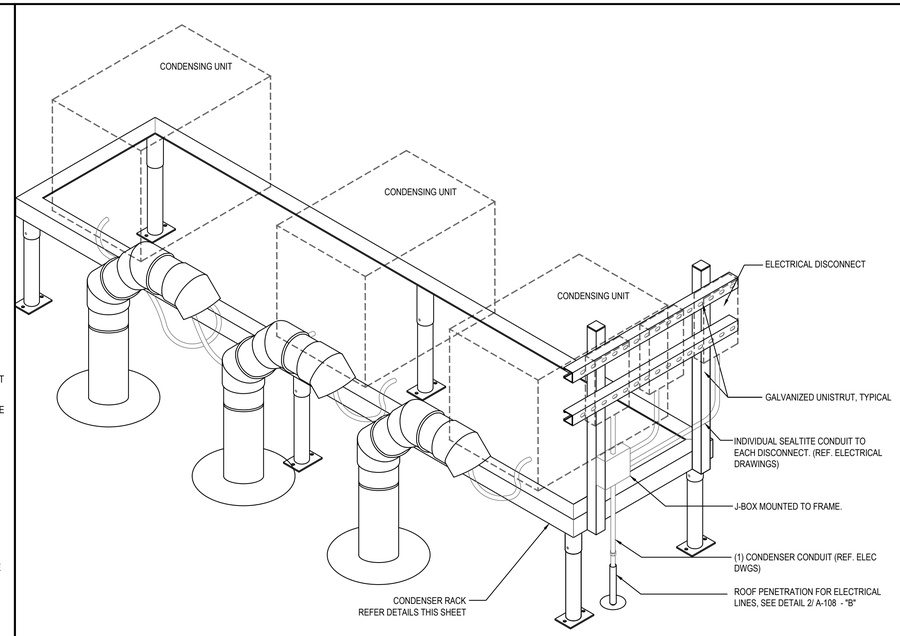

CONDENSER RACK ISOMETRIC 3

Scale= 3/4" = 1'-0" A-108

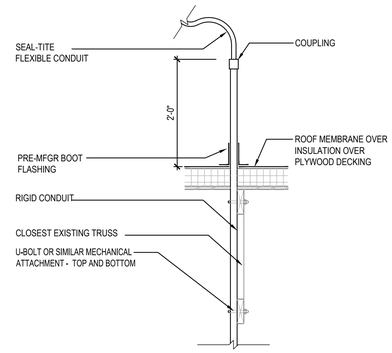

CONDITION "B" - AT CONDENSER ELECTRICAL LINES

ROOF PENETRATION DETAIL AT REF. / ELEC. LINES 2

Scale= 3/4" = 1'-0" A-108

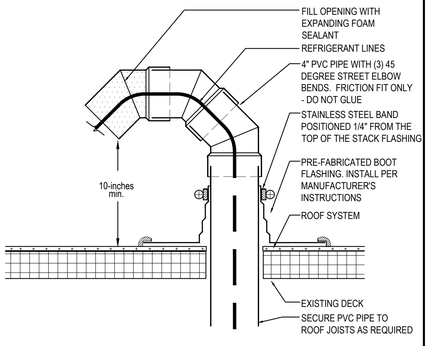

PVC ROOF PENETRATION 4

Scale= 1/2" = 1'-0" A-108



DRIVE THRU ICE MAKER PLATFORM

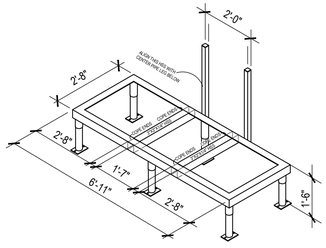

MAKE-UP AIR CONDENSING UNIT PLATFORM (REF. MEP PLAN IF USED - MA-1)

ICE, COOLER, FREEZER PLATFORM (31c, 10J-S, 32c)

DIMENSION ISOMETRICS

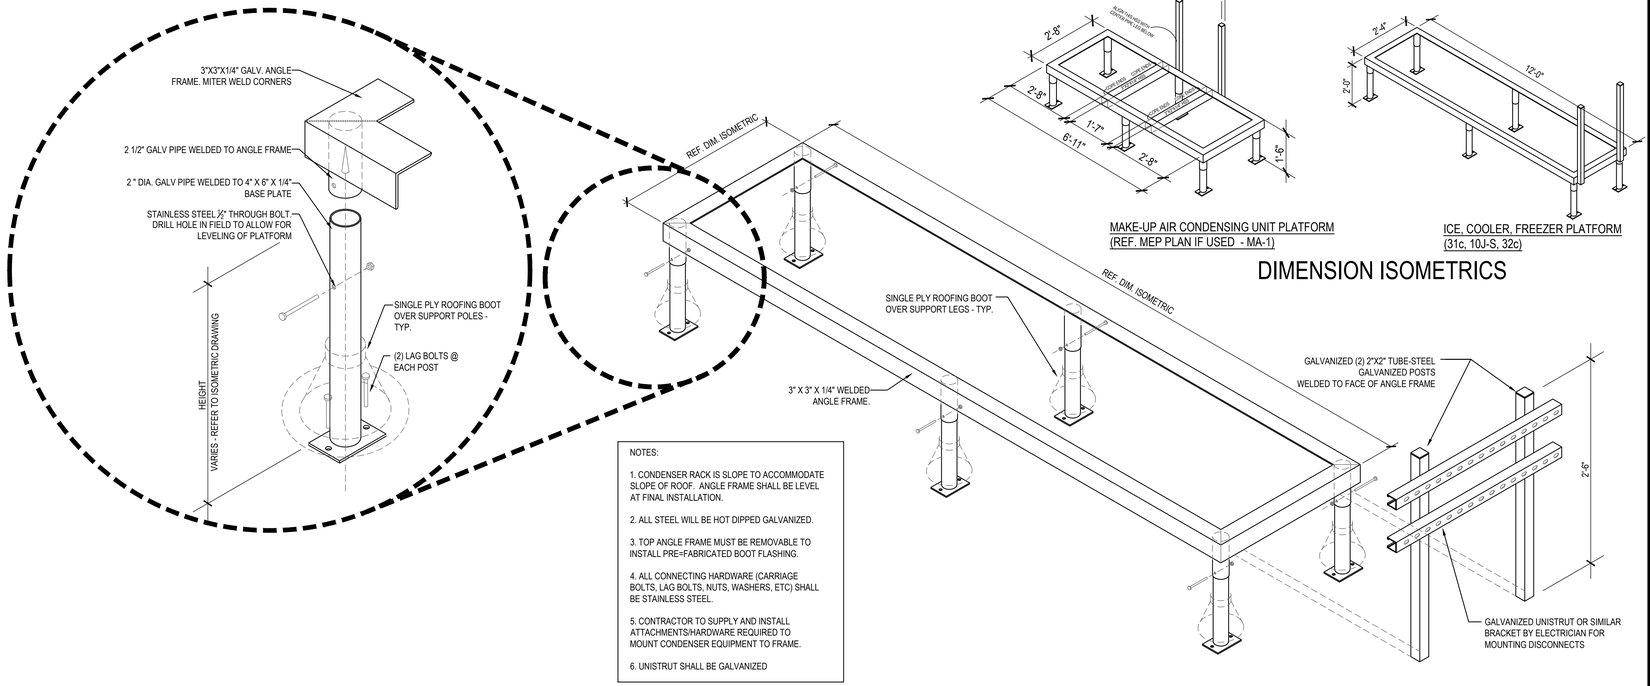

NOTES:

1. CONDENSER RACK IS SLOPE TO ACCOMMODATE SLOPE OF ROOF. ANGLE FRAME SHALL BE LEVEL AT FINAL INSTALLATION.
2. ALL STEEL WILL BE HOT DIPPED GALVANIZED.
3. TOP ANGLE FRAME MUST BE REMOVABLE TO INSTALL PRE=FABRICATED BOOT FLASHING.
4. ALL CONNECTING HARDWARE (CARRIAGE BOLTS, LAG BOLTS, NUTS, WASHERS, ETC) SHALL BE STAINLESS STEEL.
5. CONTRACTOR TO SUPPLY AND INSTALL ATTACHMENTS/HARDWARE REQUIRED TO MOUNT CONDENSER EQUIPMENT TO FRAME.
6. UNISTRUT SHALL BE GALVANIZED

FREEZER / COOLER / ICE MAKER CONDENSER RACK DETAILS 1

Scale= 3/4" = 1'-0" A-108

ISSUE FOR BID 01-30-2023

PANDA EXPRESS · CHINESE KITCHEN

PANDA EXPRESS, INC.
1683 Walnut Grove Ave.
Rosemead, California
91770
Telephone: 626.799.9898
Facsimile: 626.372.8288

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

REVISIONS:

ISSUE DATE:

ISSUE FOR PERMIT	10-20-22
ISSUE FOR BID	01-30-23

DRAWN BY: AE/SS

PANDA PROJECT #: D23503
PANDA STORE #: -
ARCH PROJECT #: 261-443

idGROUP

CARRY D. MCLAIN REGISTERED ARCHITECT AGRICULTURE NO. 106103 STATE OF TENNESSEE

10-20-22

PANDA EXPRESS

PANDA HOME 2600
NORTH RIVERSIDE DR & 2ND ST.
CLARKSVILLE, TN 37040

A-108

CONDENSER RACK DETAIL

PANDA HOME 2600 R4

ISSUE FOR BID 01-30-2023